

Спод.: 0.06 - 60.0 м³/ч Ду= _____ мм
 Гобр.: 0.06 - 60.0 м³/ч Ду= _____ мм
 Гп : 10 л/Имп

Посуточная ведомость учета параметров теплопотребления
 с 21.11.2025 по 09.12.2025

по 20.12.25

Дата	Q Гкал	Масса, тонн. Объем, м ³				Температура, °C				Давление		Время, час		Классиф ошибка	
		M1	V1	M2	V2	M1-M2 разбор	t1	t2	t1-t2	tхв	P1 атм	P2 атм	Нераб. Тн		Работы Тр
21.11.25	3.052	430.71	436.8828	422.65	427.2891	8.06	54.8	47.7	7.1	0.0	0.0	-0.0	0.00	24.00	
22.11.25	2.722	431.06	436.6875	423.00	427.2891	8.06	52.1	45.7	6.3	0.0	0.0	-0.0	0.00	24.00	
23.11.25	2.835	431.09	436.8359	423.04	427.3750	8.05	52.6	46.0	6.6	0.0	0.0	-0.0	0.00	24.00	
24.11.25	2.707	429.81	435.3281	421.77	425.9766	8.04	51.7	45.4	6.3	0.0	0.0	-0.0	0.00	24.00	
25.11.25	2.943	425.77	431.6484	417.79	422.2031	7.98	53.7	46.8	6.9	0.0	0.0	-0.0	0.00	24.00	
26.11.25	2.620	425.86	431.2422	417.91	422.0000	7.95	51.3	45.1	6.2	0.0	0.0	-0.0	0.00	24.00	
27.11.25	2.327	421.48	426.1797	413.63	417.2656	7.85	48.2	42.7	5.5	0.0	0.0	-0.0	0.00	24.00	
28.11.25	2.373	412.06	416.7266	404.38	407.9609	7.69	48.5	42.7	5.8	0.0	0.0	-0.0	0.00	24.00	
29.11.25	2.870	412.01	417.6094	404.30	408.4922	7.70	53.2	46.2	7.0	0.0	0.0	-0.0	0.00	24.00	
30.11.25	2.693	411.93	417.2656	404.22	408.2109	7.71	51.8	45.3	6.5	0.0	0.0	-0.0	0.00	24.00	
01.12.25	2.910	411.85	417.5156	404.18	408.4219	7.67	53.6	46.5	7.1	0.0	0.0	-0.0	0.00	24.00	
02.12.25	2.932	413.21	418.9141	405.47	409.7344	7.74	53.8	46.7	7.1	0.0	0.0	-0.0	0.00	24.00	
03.12.25	2.904	414.89	420.6094	407.12	411.4063	7.77	53.6	46.6	7.0	0.0	0.0	-0.0	0.00	24.00	
04.12.25	2.897	420.09	425.8516	412.25	416.5859	7.84	53.6	46.7	6.9	0.0	0.0	-0.0	0.00	24.00	
05.12.25	2.452	397.44	402.5000	388.80	392.7188	8.63	51.6	45.4	6.2	0.0	0.0	-0.0	0.00	24.00	
06.12.25	2.624	416.54	421.8516	408.57	412.6016	7.97	51.4	45.1	6.3	0.0	0.0	-0.0	0.00	24.00	
07.12.25	3.063	418.27	424.2813	410.41	414.9063	7.86	55.0	47.6	7.3	0.0	0.0	-0.0	0.00	24.00	
08.12.25	2.983	426.59	432.5469	418.58	423.0859	8.01	54.2	47.2	7.0	0.0	0.0	-0.0	0.00	24.00	
09.12.25	3.161	433.04	439.3516	424.88	429.6016	8.16	55.4	48.1	7.3	0.0	0.0	-0.0	0.00	24.00	
Итого	53.069	7983.69	8089.8281	7832.94	7913.1250	150.75	52.6	46.0	6.7	0.0	0.0	-0.0	0.00	456.00	0.00

Локализация интеграторов КМ-5


Дата	Время	Q	M1	M2	V1	V2	Тр
------	-------	---	----	----	----	----	----

09.12.25 24:00	631.668	82879.77	81328.45	84301.48	82402.00	8079.37
21.11.25 00:00	578.599	74896.08	73495.52	76211.65	74488.88	7623.37
Итого	53.069	7983.69	7832.94	8089.83	7913.13	456.00

Служебный период _____ 456.00_ час. Период норм. работы _____ 456.00_ час.

Период отключения питания (У) _____ 0.000_ час. Период функц.отказа (Е) _____ 0.000_ час.
 Период t2-t1 < min (D) _____ 0.000_ час. Период G>min (G) _____ 0.000_ час.
 Период G>max (G) _____ 0.000_ час.

Представитель абонента _____ Представитель теплоснабжающей организации _____

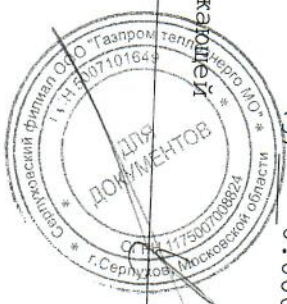

Q = 8379312 м